


TYPE	DESCRIPTION	NO. OFF
→ C	gate valves approved by the Local Authority	9
→ EP	downpipe brass screw reading	5
→ VV	CP Matheson stopcocks to M.C. cylinders or tanks	10
→ FH	FIRE HOSE post	7
→ Z	3" CP stopcocks and swivelling CP overcocks for 3 gallon automatic fire water tank, 1 on each of 19	5
→ OM	Matheson CP stopcocks to each of 19	4
→ B	Matheson CP stop to basin: 3" pipe section over main	24
→ S	3" Matheson CP stop to sink	6
→ DL	3" Matheson CP stopcocks and CP to sink	15
DP	Matheson CP stopcocks and CP to sink	4

FIRST FLOOR

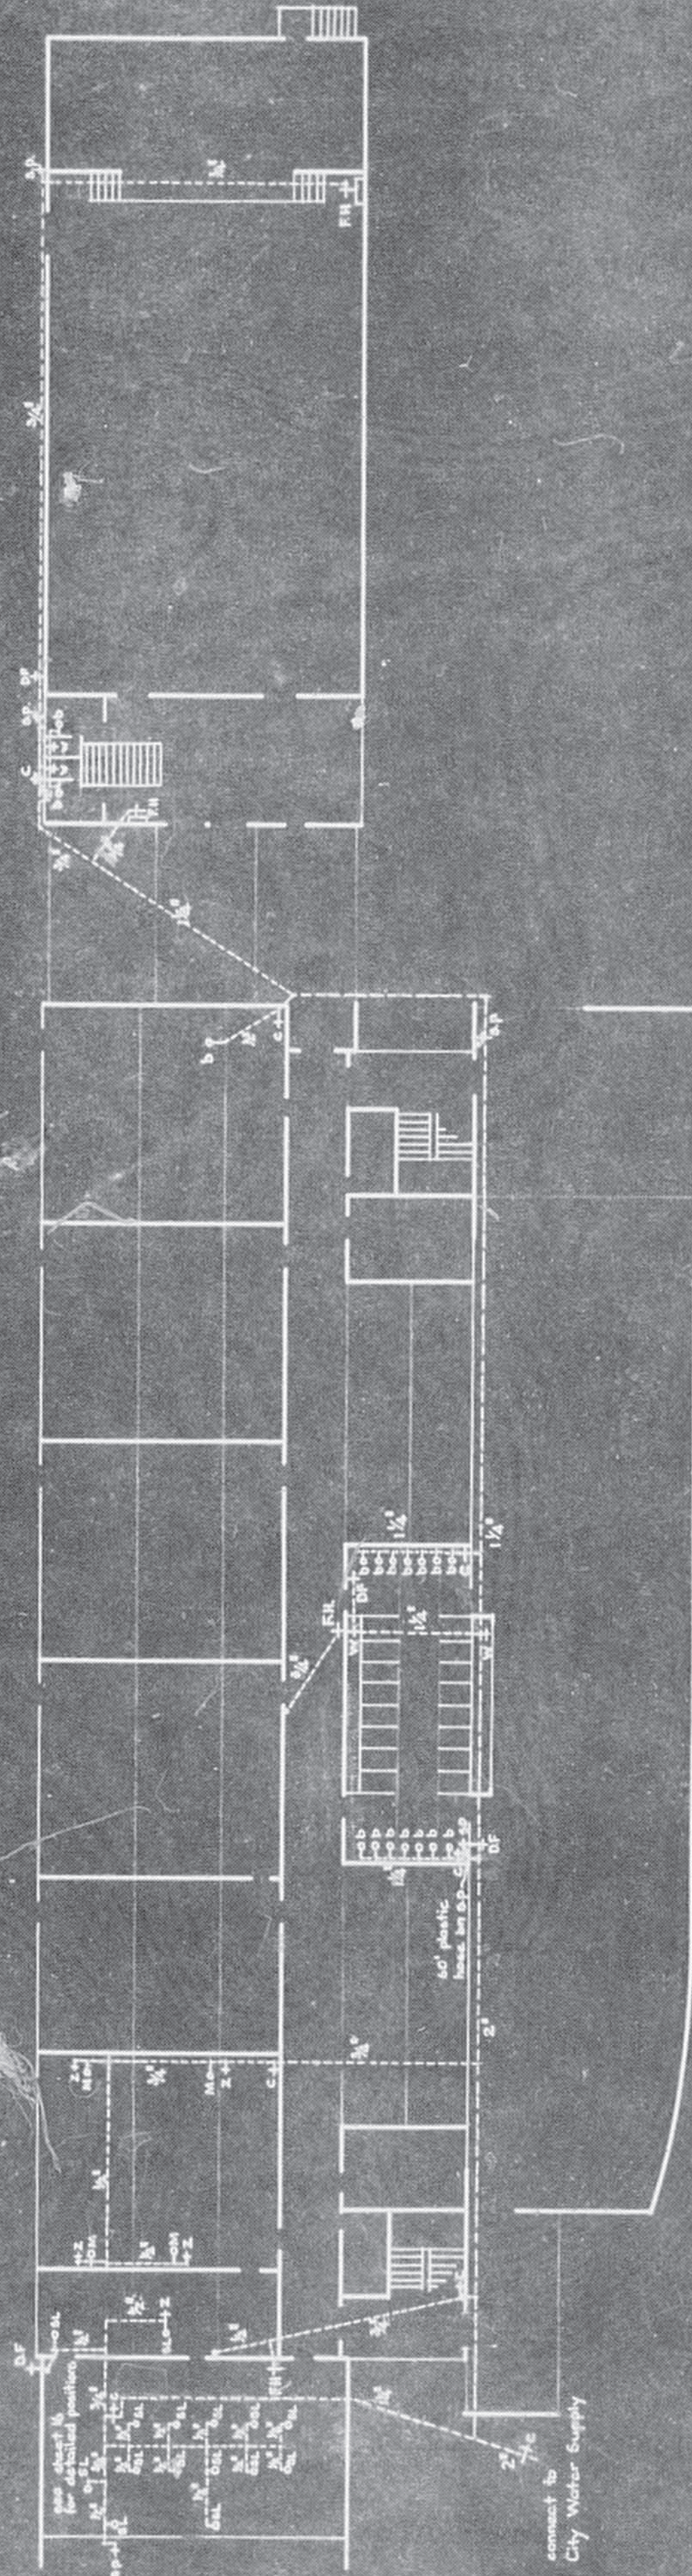

GROUND FLOOR

7